

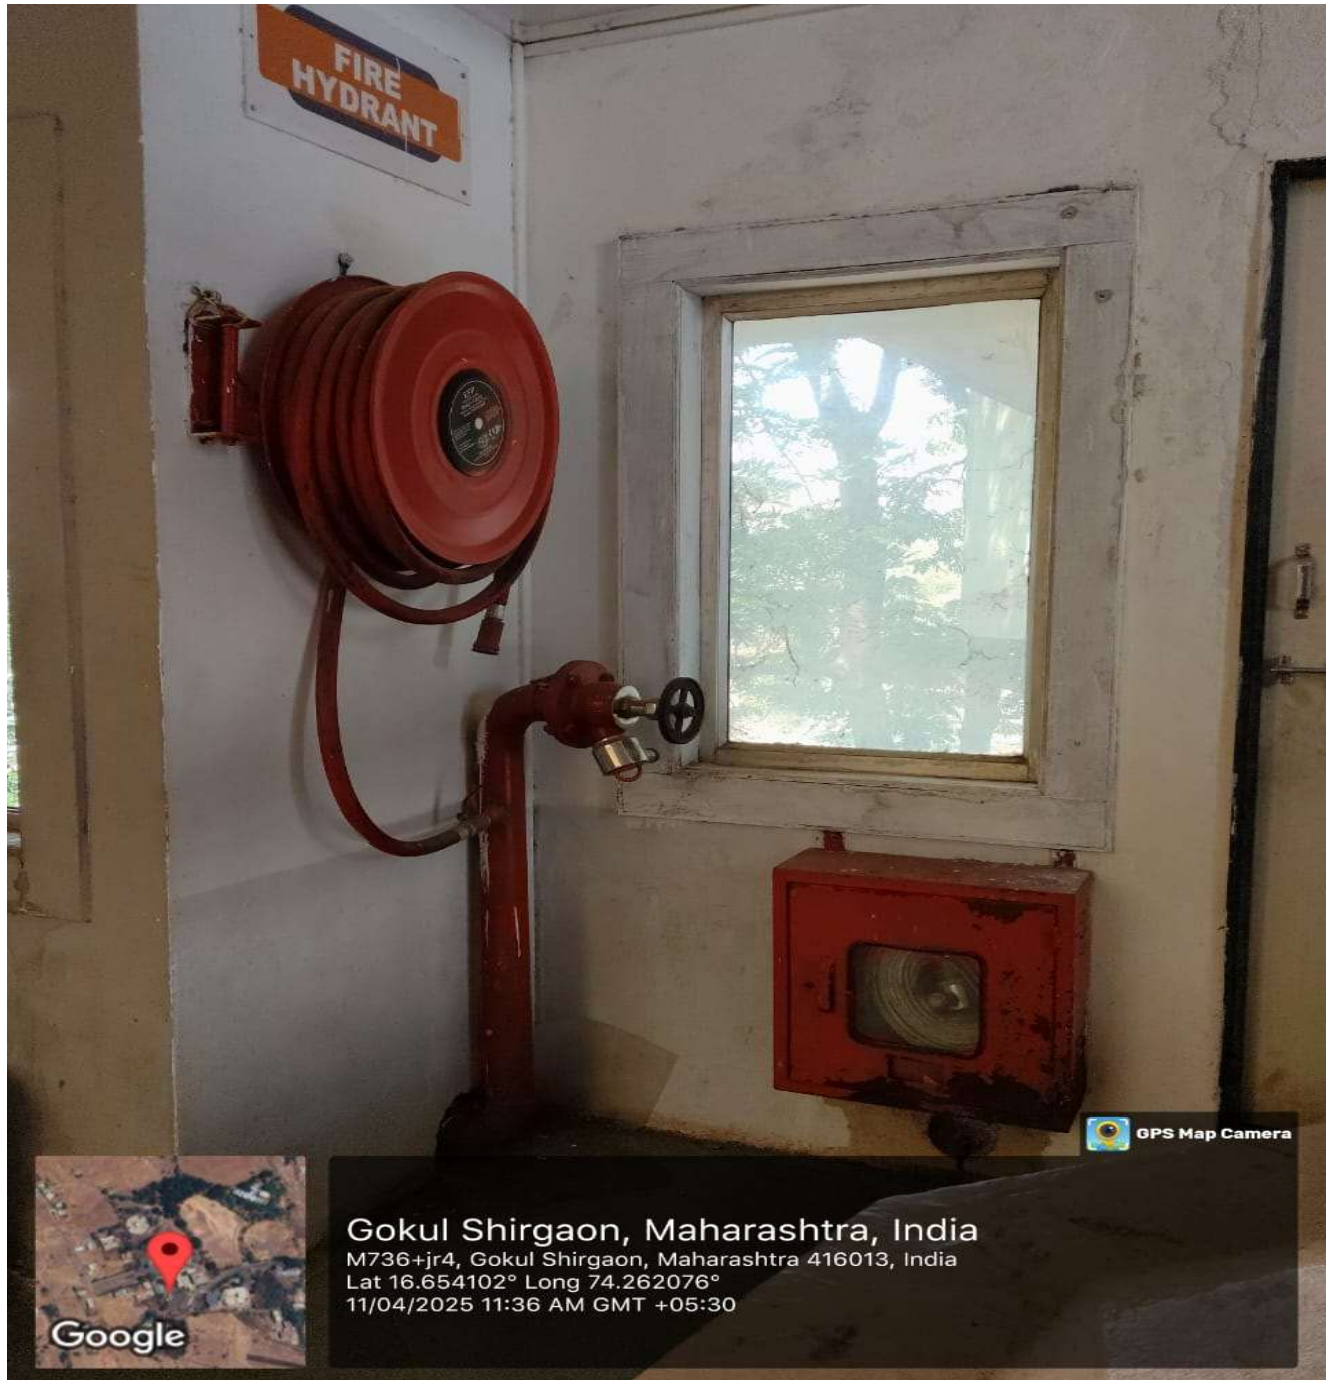


Kolhapur Institute of Technology's
College of Engineering (Autonomous), Kolhapur

Fire Fighting System





Gokul Shirgaon, Maharashtra, India
M737+97q, Kolhapur Institute Of Technology Rd, Gokul Shirgaon, Maharashtra
416013, India
Lat 16.653238° Long 74.263174°
17/04/2025 10:21 AM GMT +05:30

DATE: 01.01.2025.

FORM B

{See section 3(3) and rules 4 (2)}

Six monthly Certification to be given in every January and July by the occupier for compliance of the fire prevention and life safety measures.

CERTIFICATE

Certified that I/we have carried out inspections of the fire prevention and life safety measures installed in following building or premises namely.

**Kolhapur Institute of Technology's
College Of Engineering Kolhapur**
R.S. No. 199B/1-3, Gokul Shirgaon,
Kolhapur- 416 234.

I/ We further certify that this installation in the above-mentioned buildings is maintained in good repair and efficient conditions during the period **1st January 2025 to 30th June 2025**, as required under the provision of the Maharashtra Fire Prevention & Life Safety Measure Act, 2006(**Mah-III of 2007**). The detail of the inspection & maintenance of installation carried out by me/us are mentioned in the report appended her with

Details of inspection and maintenance /servicing are as per attached list

Name, Signature &
Stamp of the organization

License No: MFS/LA/RF-224.
Next Due Date: 30.06.2025.

ZUBAIR Digitally signed
IBRAHIM by ZUBAIR
SUBHEDA IBRAHIM
R SUBHEDAR
Date: 2025.01.01
13:45:24 +05'30'
Signature & address of
the licensed agency.



DATE: - 01.01.2025.

TEST CERTIFICATE

{See section 3(3) and rules 4 (2)}

Certified that I /we have carried out inspection of fire prevention & Life Safety Measures installed in the following building or premises namely.
(Building Numbers, society Name & address-

**Kolhapur Institute of Technology's
College Of Engineering Kolhapur**
R.S. No. 199B/1-3, Gokul Shirgaon,
Kolhapur- 416 234.

We further certify that these installation in the above-mentioned buildings are maintained in good repair and efficient conditions during the period ONE YEAR, as required under the provision of the Maharashtra Fire Prevention & Life Safety Measure Act, 2006(Mah-III of 2007). The detail of the inspection & maintenance of installation carried out by me/us are mentioned as below herewith.

Details of inspection & Maintenance/Servicing

Following List of Material are installed & tested successfully.

Sr. No.	Particulars	Qty.	Remark
1	Fire Pump 5 Hp	01 Nos.	Ok
2	Hose Reel Drum Set	03 Nos.	Ok
3	Hydrant Valve Point	03 Nos.	Ok
4	ABC Type 05 Kg Fire Extinguisher	10 Nos.	Ok
5	DCP Type 05 Kg Fire Extinguisher	05 Nos.	Ok
6	Co2 Type 02 Kg Fire Extinguisher	05 Nos.	Ok

License No: MFS/LA/RF-224.

Next Due Date: 30.06.2025.



GLOBAL PROTECTION SYSTEMS

S. S. S. S.
PROPRIETOR